


3" to 10" Manifold Above Ground Backflow Preventers

INSTALLATION DRAWING #017, OCTOBER 11, 2007 M.T.B.

6" thick minimum formed and troweled smooth concrete pad
that extends at least 4" beyond the edges of the box
and is 3/4" to 1-1/2" above finished grade

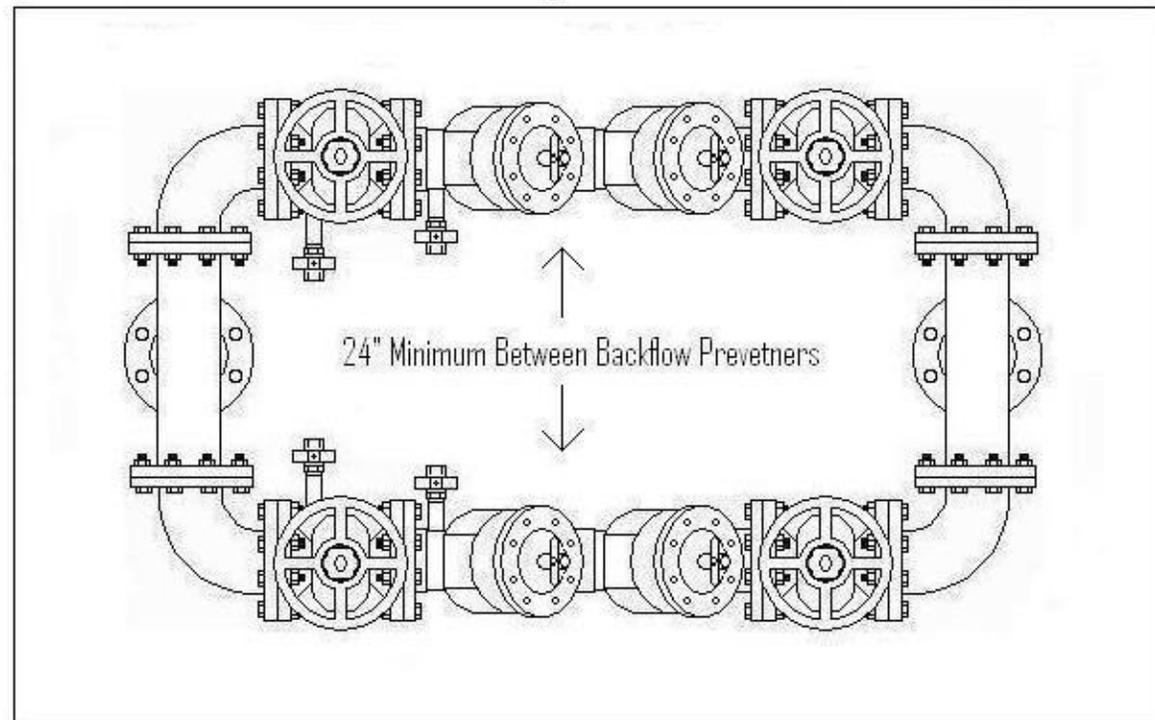

* Heat Source
Required for
Above Ground
Detector
Assemblies