


FOR CURRENT SIDEWALK REQUIREMENT'S REFER TO CITY OF HIGH POINT DEVELOPMENT ORDINANCE (CHAPTER 6, 9-6-16(e)).

STREET SIDE VIEW

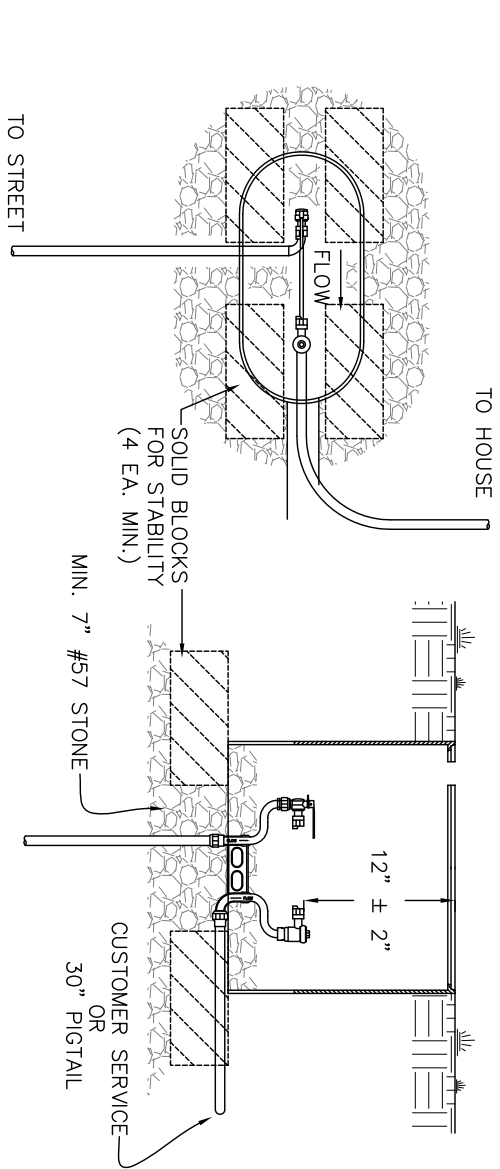

TOP VIEW

STREET FRONT VIEW

- NOTES:**
- A. THE CITY SERVICE LATERAL SHALL EXTEND PERPENDICULAR FROM THE WATER MAIN TO THE METER SETTER AND MAINTAIN THE SAME COVER AS REQUIRED FOR THE WATER MAIN. THE ONLY EXCEPTION IS IN A CUL-DE-SAC. IN THIS CASE, ONE HORIZONTAL BEND WILL BE ALLOWED. HOWEVER, THE BEND MUST BE FIELD LOCATED AND SHOWN ON THE AS-BUILTS.
 - B. ALL WATER TAPS SHALL BE WET TAPS.
 - C. APPROVED CORPORATIONS:
 - 3/4": -MUELLER 300 BALL CORPORATION VALVE COMPRESSION
 - B-25008N SERIES
 - A.Y. McDONALD BRASS 74701BT-3/4"
 - FORD FB1000-3GNL
 - MUELLER 300 BALL CORPORATION VALVE 1";
 - B-25008N SERIES
 - A.Y. McDONALD BRASS 74701BT-1"
 - FORD FB1000-4GNL
 - D. FOR RIBBON PAVEMENT ROADS, THE WATER METER BOX AND SETTER SHALL BE LOCATED WITHIN THE GRASS STRIP, WHICH IS LOCATED 2' INSIDE OF THE RIGHT-OF-WAY LINE.
 - E. NO KINKS ALLOWED IN THE SERVICE. ANY KINKED OR DAMAGED TUBING SHALL BE REMOVED AND REPLACED.

CITY OF HIGH POINT
NORTH CAROLINA
ENGINEERING SERVICES DEPARTMENT
APPROVED FEBRUARY 2, 2007
BPK
DIRECTOR

ISSUED 02-02-07	9-15-10
REVISIONS	2-6-14

STANDARD DRAWING FOR
3/4" AND 1" SERVICE LINE INSTALLATION (NEW)
FOR 3/4" AND 1" WATER SERVICES