



TRANSVERSE EXPANSION JOINT
IN CURB AND GUTTER

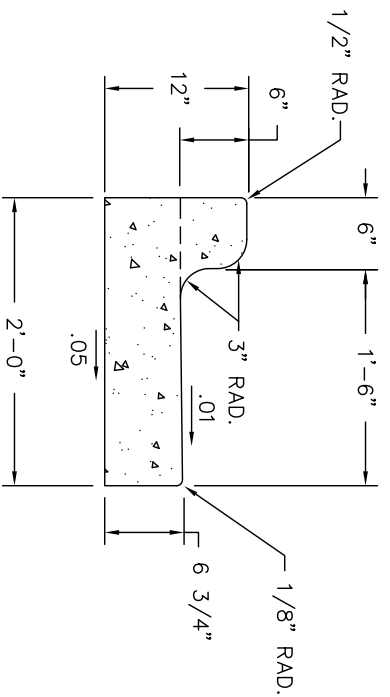

2'-0" SPILL CURB AND GUTTER
SPILL GUTTER MAY BE USED ONLY WHEN DIRECTED
ON THE PLANS OR AS APPROVED BY THE DIRECTOR.

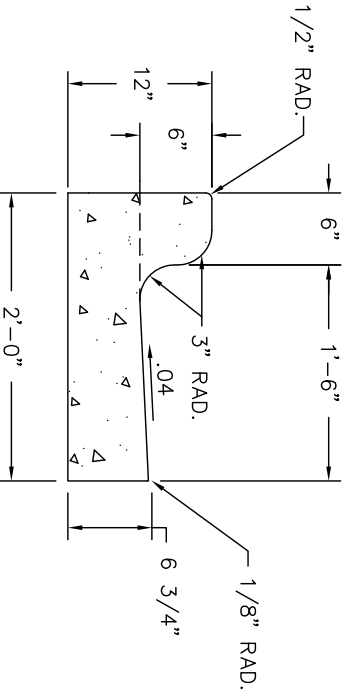

2'-0" CURB AND GUTTER

- NOTES:
- PLACE CONTRACTION JOINTS AT 10' INTERVALS, EXCEPT THAT A 15' SPACING MAY BE USED WHEN A MACHINE IS USED OR WHEN SATISFACTORY SUPPORT FOR THE FACE FORM CAN BE OBTAINED WITHOUT THE USE OF TEMPLATES AT 10' INTERVALS.
 - JOINT SPACING MAY BE ALTERED IF REQUIRED BY THE ENGINEER.
 - CONTRACTION JOINTS MAY BE INSTALLED WITH THE USE OF TEMPLATES OR FORMED BY OTHER APPROVED METHODS. CONSTRUCT NON-TEMPLATE FORMED JOINTS A MIN. OF 1 1/2" DEEP.
 - FILL ALL CONSTRUCTION JOINTS WITH JOINT FILLER AND SEALER.
 - SPACE EXPANSION JOINTS AT 90' INTERVALS AND ADJACENT TO ALL RIGID OBJECTS.
 - CONSTRUCT THE CONCRETE IN ACCORDANCE WITH SECTION 825 AND SECTION 846 OF THE MOST RECENT EDITION OF THE NCDOT STANDARD SPECIFICATIONS FOR ROADS & STRUCTURES.

CITY OF HIGH POINT
NORTH CAROLINA
ENGINEERING SERVICES DEPARTMENT

APPROVED APRIL 12, 2007

.....
DIRECTOR

ISSUED 4-12-07
REVISIONS

REVISIONS

STANDARD DRAWING FOR

2'-0" CURB AND GUTTER

C-G_24.DWG

503.00

SHEET 1 OF 1