



PLAN VIEW

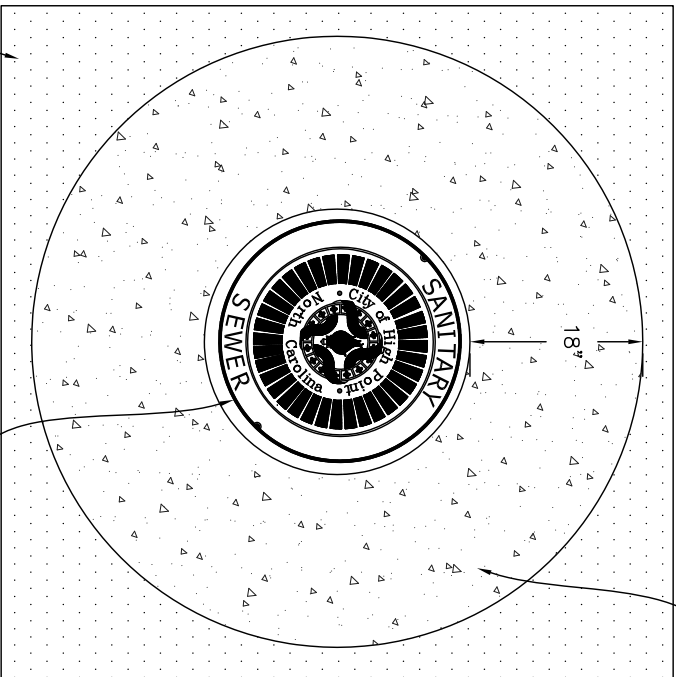

CONCRETE COLLAR - 18" MIN. WIDTH X 8" MIN. DEPTH

THE COVER SHALL READ "STORM WATER", "SANITARY SEWER", OR "WATER" AS APPLICABLE BY TYPE OF UTILITY. SEE CITY STD. NO.'S 307 OR 412 FOR DETAILS.

SECTION VIEW

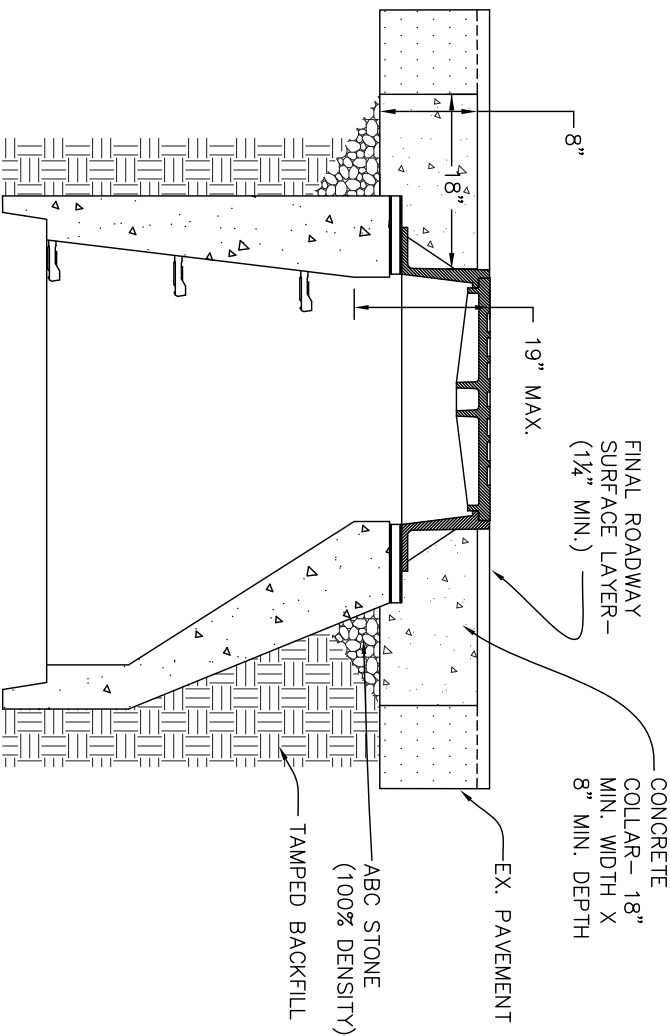

- NOTES:
- A. A CONCRETE COLLAR SHALL BE UTILIZED ON ALL ROADWAY STRUCTURE ADJUSTMENTS.
  - B. CONCRETE SHALL BE A MINIMUM OF 4000 PSI HIGH EARLY STRENGTH PCC.
  - C. THE CONCRETE COLLAR SHALL BE POURED IN ONE CONTINUOUS LIFT.
  - D. THE RING CASTING SHALL BE SET TO BE PARALLEL TO THE PAVEMENT SLOPE. THE RING CASTING SHALL BE SET TO BE LEVEL WITH THE FINAL ROADWAY SURFACE.
  - E. REMOVE ALL FAULTY EXISTING BRICKWORK AND REPLACE WITH NEW BRICK MASONRY.

CITY OF HIGH POINT  
NORTH CAROLINA

ENGINEERING SERVICES DEPARTMENT

APPROVED: APRIL 12, 2007

DIRECTOR

ISSUED 4-12-07  
REVISIONS

STANDARD DRAWING FOR

CONCRETE COLLAR FOR ROADWAY STRUCTURES

FOR MANHOLE & OTHER CASTINGS IN PAVEMENT

MHADJ.DWG

501.00

SHEET 1 OF 1