


PLAN

- NOTES:
- A. SAW CUT A MINIMUM OF 2" DEEP ALONG THE JOINT.
  - B. IF THE ENGINEER SO DEMS, THE CONTRACTOR WILL BE REQUIRED TO REMOVE AND REPLACE DAMAGED CURB & GUTTER HARMED DURING THE DRAIN INSTALLATION.
  - C. AN INSPECTION BY THE ENGINEERING SERVICES DEPT. IS REQUIRED PRIOR TO PLACEMENT OF MATERIAL.
  - D. CONCRETE SHALL BE A MINIMUM CLASS B, 2500 PSI CONCRETE.
  - E. DESIGN OF DRAIN THRU CURB & GUTTER SHALL BE SUFFICIENT SUCH THAT ROAD RUNOFF WILL NOT BACKFLOW UP THE DRAIN.

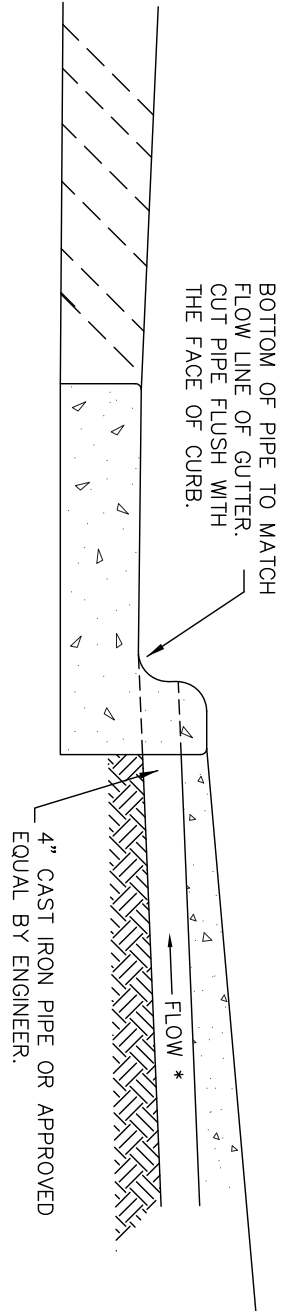

ELEVATION

CITY OF HIGH POINT  
 NORTH CAROLINA  
 ENGINEERING SERVICES DEPARTMENT  
 APPROVED APRIL 12, 2007  
 BSK  
 DIRECTOR

ISSUED 4-12-07  
 REVISIONS

STANDARD DRAWING FOR  
 DRAIN THRU CURB AND GUTTER

C-G\_DRAIN.DWG

506.00

SHEET 1 OF 1