



SECTION A-A

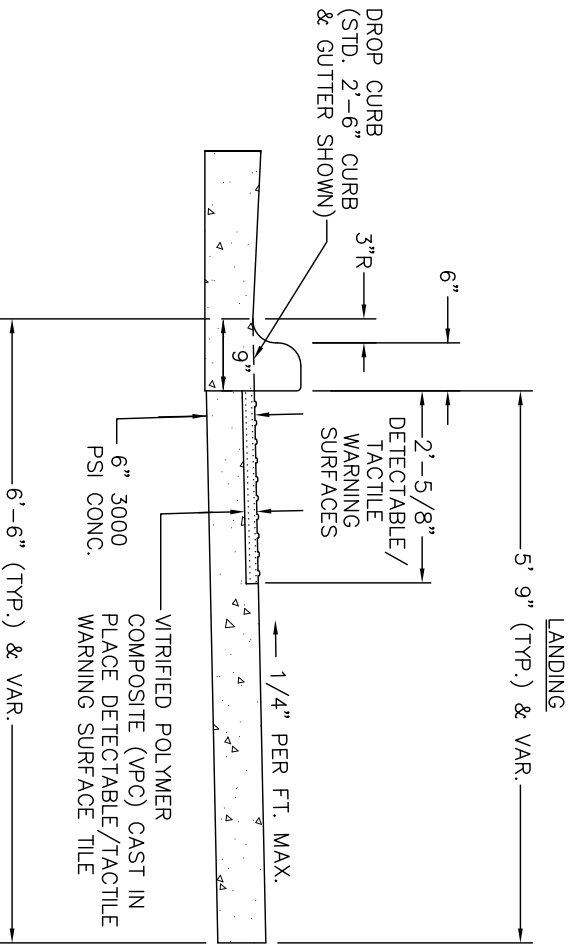

SECTION B-B

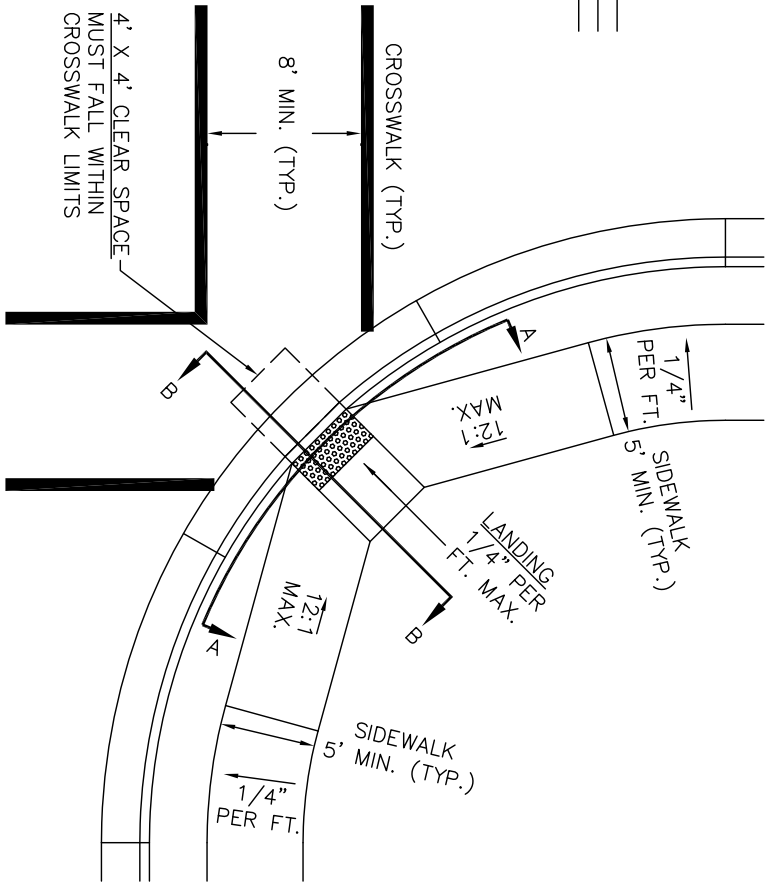

NOTES

- A. SIDEWALKS AND RAMPS ARE TO BE CONSTRUCTED ON A 1/4" PER FT. MAX. CROSS SLOPE. THE RUNNING SLOPES OF THE RAMP ARE NOT TO EXCEED 12:1 AT ANY LOCATION WHERE PEDESTRIAN TRAFFIC CROSSES THE RAMP. THE RUNNING SLOPE OF THE PANELS WILL VARY BASED ON THE GRADE ACHIEVED BY THE RETURN CURB RAMP AND THE LANDING.
- B. LANDING SHALL BE CONSTRUCTED ON A 1/4" PER FT. MAX. SLOPE IN ALL DIRECTIONS.
- C. CURB FACE MUST BE ALIGNED WITH CROSSWALK.
- D. USE ONLY WITH PERMISSION OF COHP TRANSPORTATION DEPT.

CITY OF HIGH POINT
 NORTH CAROLINA
 ENGINEERING SERVICES DEPARTMENT
 APPROVED FEBRUARY 6, 2014
 BSK
 DIRECTOR

ISSUED	2-6-14
REVISIONS	

STANDARD DRAWING FOR
 WHEELCHAIR RAMP (SPECIAL)
 RADIUS TYPE